


Long Beach Elementary School

Hydrant
990 gpm

Hydrant
990 gpm

Fire Dept.
Connection

Hydrant
1,000 gpm

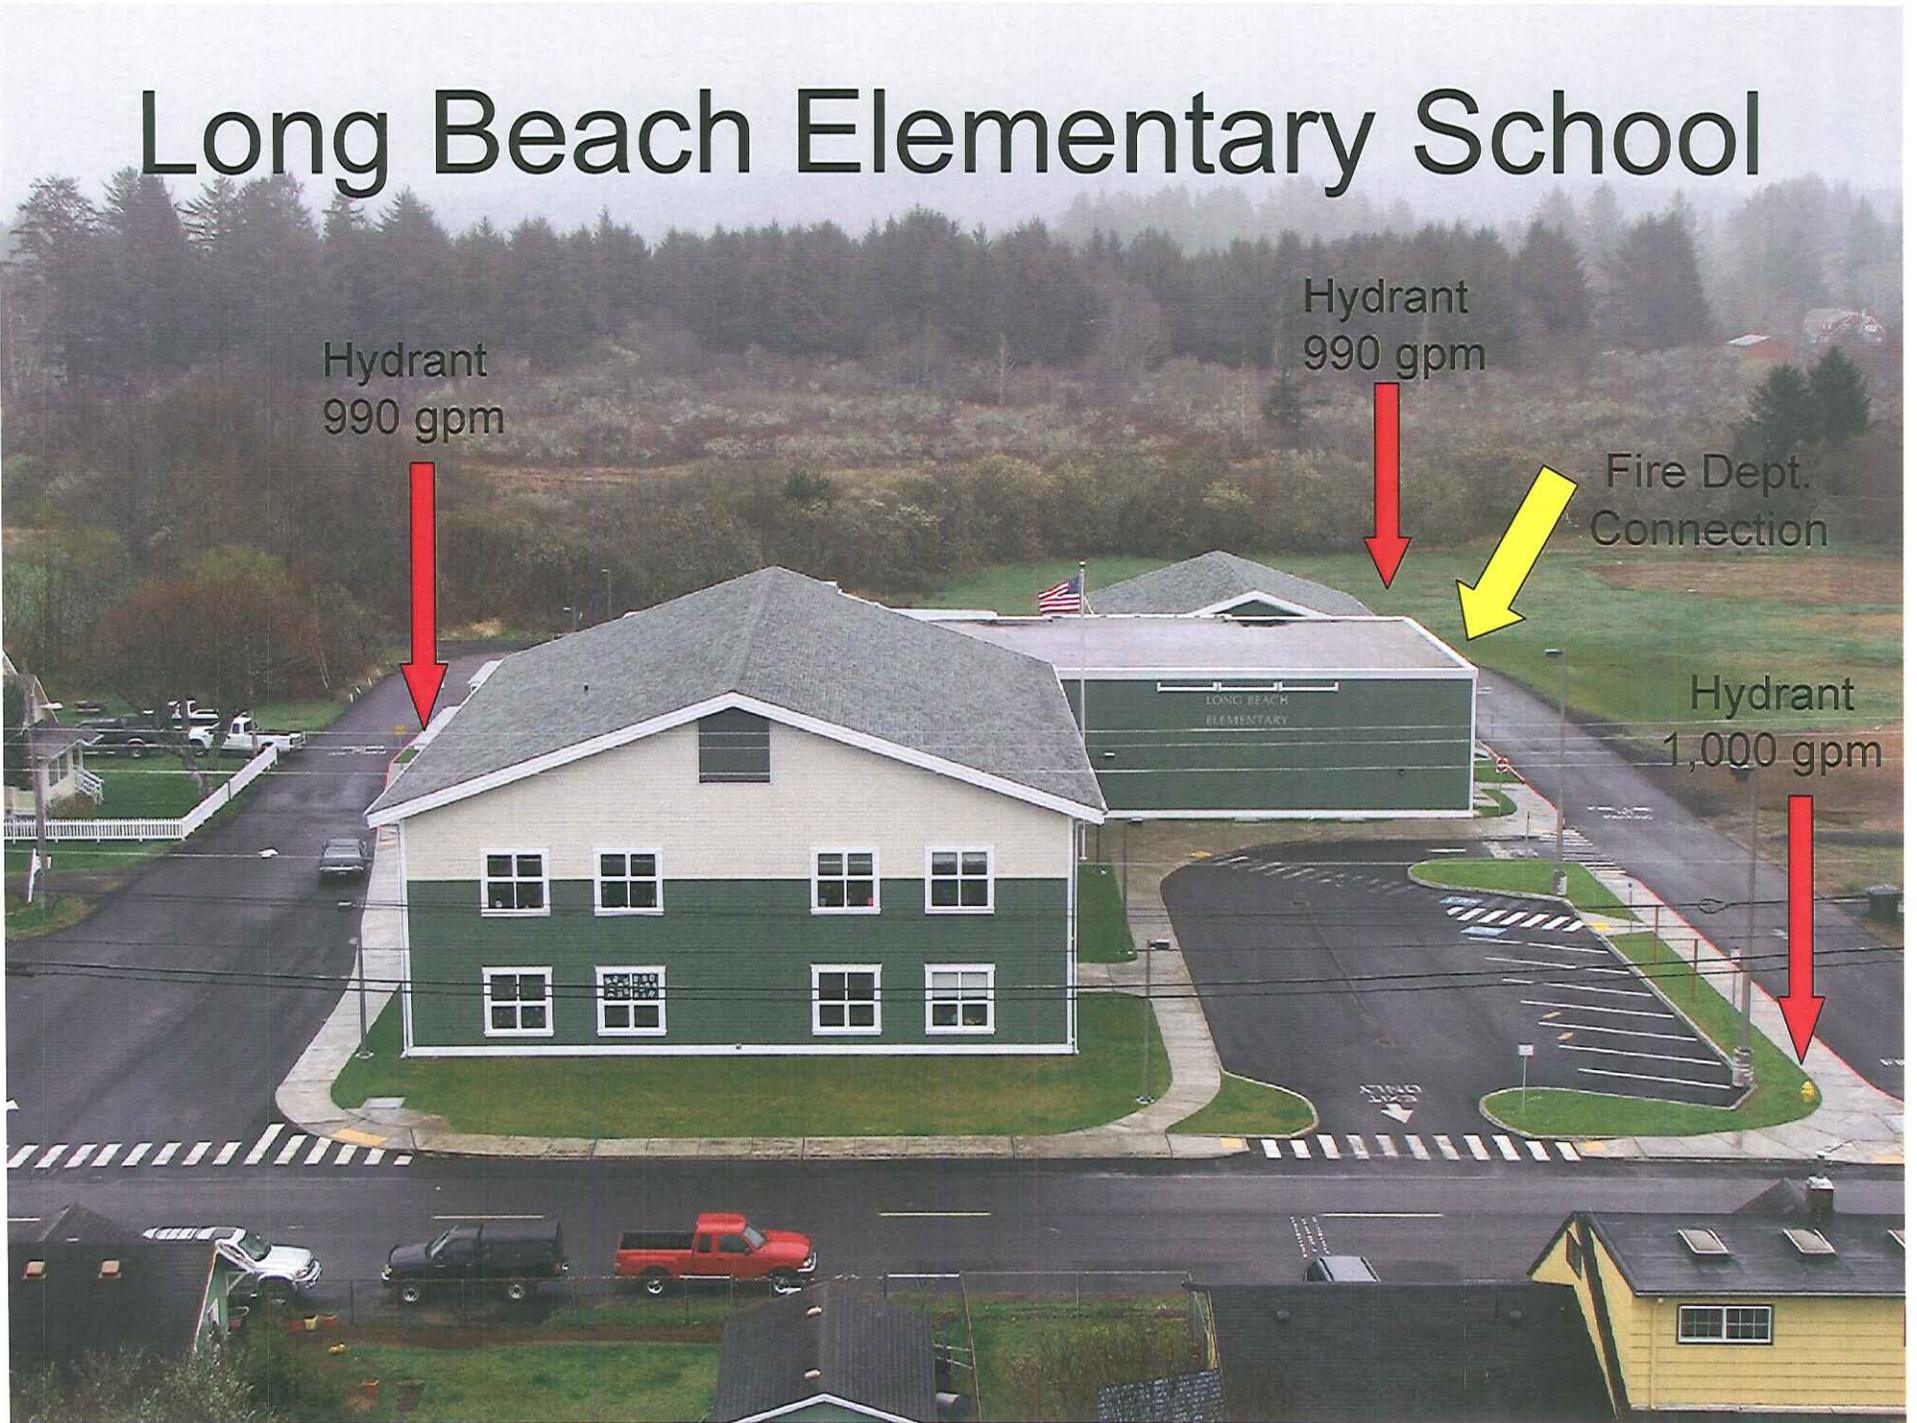

Long Beach Elementary School

- 300 Students, 1,000 People Maximum
- 3 Fire Hydrants
- 3,000 Gallon Fuel Oil Tank
- Fire Sprinklers in all rooms, Play Area and overhangs greater than 4 feet
- Fire, Heat, and Motion detection Alarms

Stairwell Locations

